

New Stanton Volunteer Fire Department


New Stanton, PA

This report was generated on 1/1/2019 1:40:31 PM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 01/01/2018 | End Date: 12/31/2018

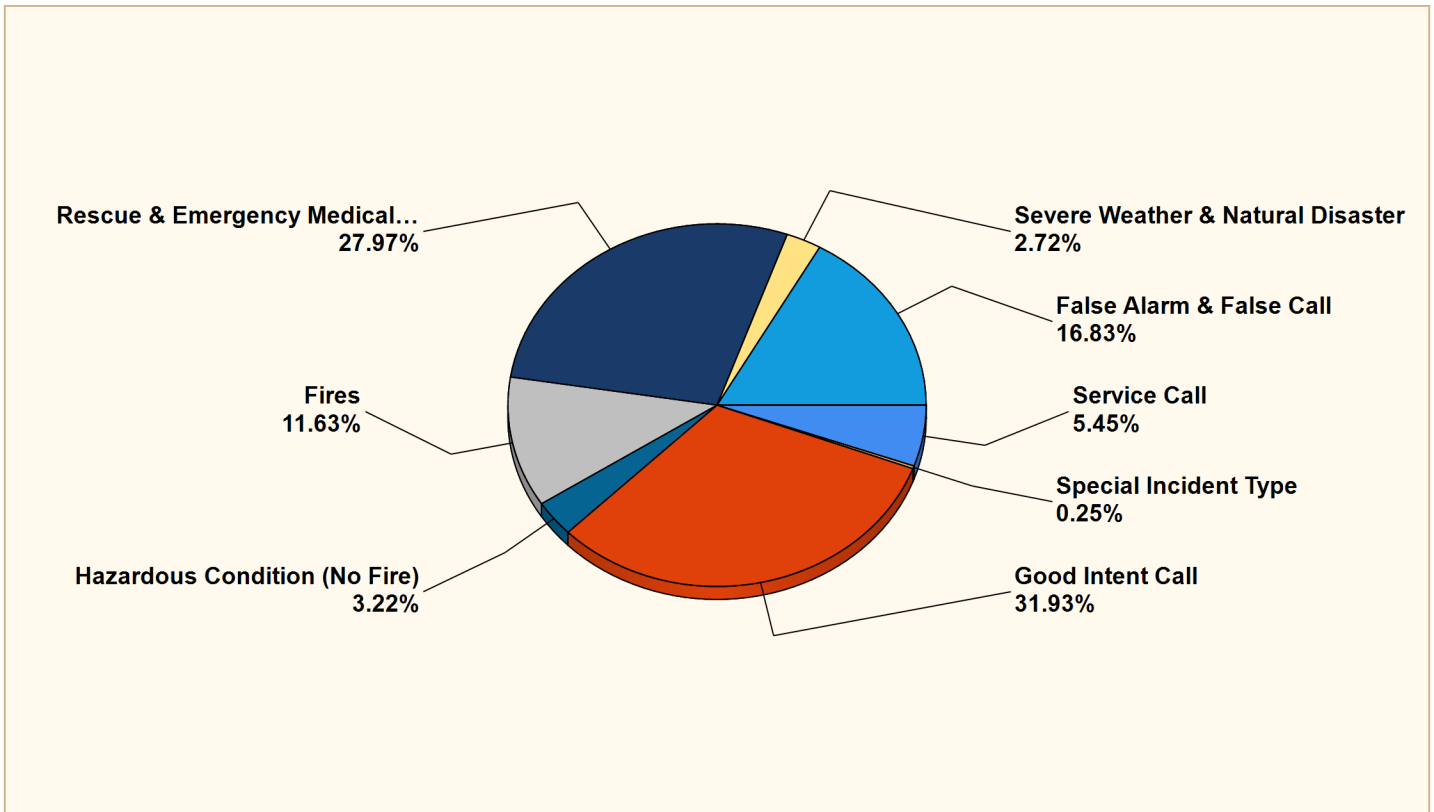

| MAJOR INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|------------------------------------|-------------|----------------|
| Fires | 47 | 11.63% |
| Rescue & Emergency Medical Service | 113 | 27.97% |
| Hazardous Condition (No Fire) | 13 | 3.22% |
| Service Call | 22 | 5.45% |
| Good Intent Call | 129 | 31.93% |
| False Alarm & False Call | 68 | 16.83% |
| Severe Weather & Natural Disaster | 11 | 2.72% |
| Special Incident Type | 1 | 0.25% |
| TOTAL | 404 | 100.00% |

Only REVIEWED incidents included. Summary results for a major incident type are not displayed if the count is zero.



Detailed Breakdown by Incident Type

| INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|--|-------------|----------------|
| 100 - Fire, other | 2 | 0.50% |
| 111 - Building fire | 11 | 2.72% |
| 112 - Fires in structure other than in a building | 1 | 0.25% |
| 113 - Cooking fire, confined to container | 4 | 0.99% |
| 118 - Trash or rubbish fire, contained | 2 | 0.50% |
| 131 - Passenger vehicle fire | 4 | 0.99% |
| 132 - Road freight or transport vehicle fire | 6 | 1.49% |
| 140 - Natural vegetation fire, other | 2 | 0.50% |
| 141 - Forest, woods or wildland fire | 4 | 0.99% |
| 142 - Brush or brush-and-grass mixture fire | 6 | 1.49% |
| 150 - Outside rubbish fire, other | 2 | 0.50% |
| 154 - Dumpster or other outside trash receptacle fire | 1 | 0.25% |
| 161 - Outside storage fire | 1 | 0.25% |
| 162 - Outside equipment fire | 1 | 0.25% |
| 300 - Rescue, EMS incident, other | 1 | 0.25% |
| 311 - Medical assist, assist EMS crew | 46 | 11.39% |
| 320 - Emergency medical service, other | 2 | 0.50% |
| 322 - Motor vehicle accident with injuries | 34 | 8.42% |
| 324 - Motor vehicle accident with no injuries. | 28 | 6.93% |
| 352 - Extrication of victim(s) from vehicle | 1 | 0.25% |
| 363 - Swift water rescue | 1 | 0.25% |
| 400 - Hazardous condition, other | 2 | 0.50% |
| 410 - Combustible/flammable gas/liquid condition, other | 1 | 0.25% |
| 411 - Gasoline or other flammable liquid spill | 2 | 0.50% |
| 412 - Gas leak (natural gas or LPG) | 2 | 0.50% |
| 424 - Carbon monoxide incident | 2 | 0.50% |
| 440 - Electrical wiring/equipment problem, other | 1 | 0.25% |
| 443 - Breakdown of light ballast | 1 | 0.25% |
| 444 - Power line down | 1 | 0.25% |
| 445 - Arcing, shorted electrical equipment | 1 | 0.25% |
| 500 - Service Call, other | 3 | 0.74% |
| 510 - Person in distress, other | 1 | 0.25% |
| 511 - Lock-out | 1 | 0.25% |
| 520 - Water problem, other | 7 | 1.73% |
| 521 - Water evacuation | 2 | 0.50% |
| 551 - Assist police or other governmental agency | 3 | 0.74% |
| 571 - Cover assignment, standby, moveup | 5 | 1.24% |
| 611 - Dispatched & cancelled en route | 126 | 31.19% |
| 622 - No incident found on arrival at dispatch address | 1 | 0.25% |
| 631 - Authorized controlled burning | 1 | 0.25% |
| 661 - EMS call, party transported by non-fire agency | 1 | 0.25% |
| 700 - False alarm or false call, other | 6 | 1.49% |
| 730 - System malfunction, other | 13 | 3.22% |
| 731 - Sprinkler activation due to malfunction | 1 | 0.25% |
| 733 - Smoke detector activation due to malfunction | 6 | 1.49% |
| 735 - Alarm system sounded due to malfunction | 7 | 1.73% |
| 736 - CO detector activation due to malfunction | 1 | 0.25% |
| 740 - Unintentional transmission of alarm, other | 4 | 0.99% |
| 741 - Sprinkler activation, no fire - unintentional | 1 | 0.25% |
| 743 - Smoke detector activation, no fire - unintentional | 17 | 4.21% |
| 744 - Detector activation, no fire - unintentional | 3 | 0.74% |
| 745 - Alarm system activation, no fire - unintentional | 9 | 2.23% |
| 812 - Flood assessment | 11 | 2.72% |
| 900 - Special type of incident, other | 1 | 0.25% |
| TOTAL INCIDENTS: | 404 | 100.00% |

Only REVIEWED incidents included. Summary results for a major incident type are not displayed if the count is zero.

